

BROADLAND GROUP LIMITED

CERTIFICATE OF REOCCUPATION

Client: <u>DSR DEMOLITION, STATION ROAD, DECKEN, SHEFFIELD.</u>		Project Number: <u>1544/3223/01</u>	
Site Address: <u>LOWFIELD SCHOOL, OLSAN AVE, YORK.</u>		Date Completed: <u>17/1/10</u>	
Enclosure Location: <u>MIN STONE. (ANASTA 1)</u>		Plan of works reference: <u>DSR/10/01/ANASTA</u>	
Contractor Details: <u>DSR DEMO.</u>		Contractor representative: <u>[Signature]</u>	
Acknowledgment from contractor of initial contractor visual inspection: <u>[Signature]</u>		Print: <u>S. WALKER</u>	
STAGE 1 - PRELIMINARY ASSESSMENT			
Plan of work defines entire work area / scope of works		Comments: <u>PERMIT OF AID TO CEILING (ALLOW 19m)</u>	
Are the following intact and operable - work area, enclosure / air extraction, hygiene facilities		Yes / No <u>Yes / No</u>	
Are the following areas and their immediate surroundings free from obvious asbestos debris and waste sacks		Yes / No <u>Yes / No</u>	
Skip area / waste route		Yes / No <u>Yes / No</u>	
Transit route		Yes / No <u>Yes / No</u>	
Hygiene facilities		Yes / No <u>Yes / No</u>	
Enclosure / work area		Yes / No <u>Yes / No</u>	
Photos		Yes / No <u>Yes / No</u>	
Result - <u>PASS</u>		Name: <u>K. Palmer</u> Signature: <u>[Signature]</u>	
Date: <u>15/1/10</u>		Time: <u>17.40</u>	
STAGE 2 - VISUAL INSPECTION			
Air lock / bag lock / enclosure are free of waste bags, material & unnecessary equipment		Comments: <u>Yes / No</u>	
All ACMs have been completely removed from the underlying surfaces		Yes / No <u>Yes / No</u>	
Interior surfaces inside the enclosure / airlock / baglock are free from debris & fine settlement		Yes / No <u>Yes / No</u>	
Photos		Yes / No <u>Yes / No</u>	
Result - <u>PASS</u>		Name: <u>K. Palmer</u> Signature: <u>[Signature]</u>	
Date: <u>15/1/10</u>		Time: <u>18.05</u>	

BROADLAND GROUP LIMITED


Project No BGL/S223/03

Date 17/1/10


Site: Longfields School

Location: Ken Street

Site Layout Plan

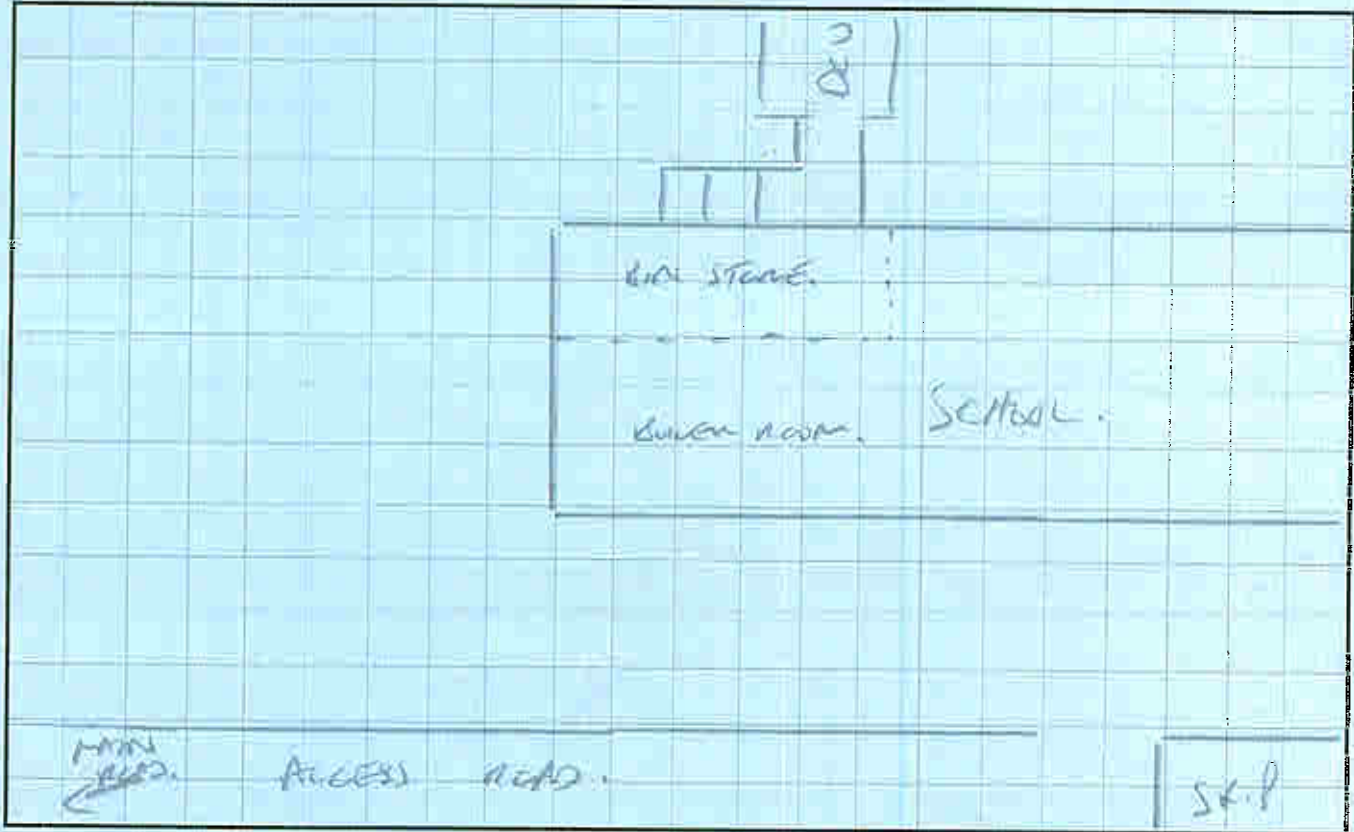

Enclosure Plan

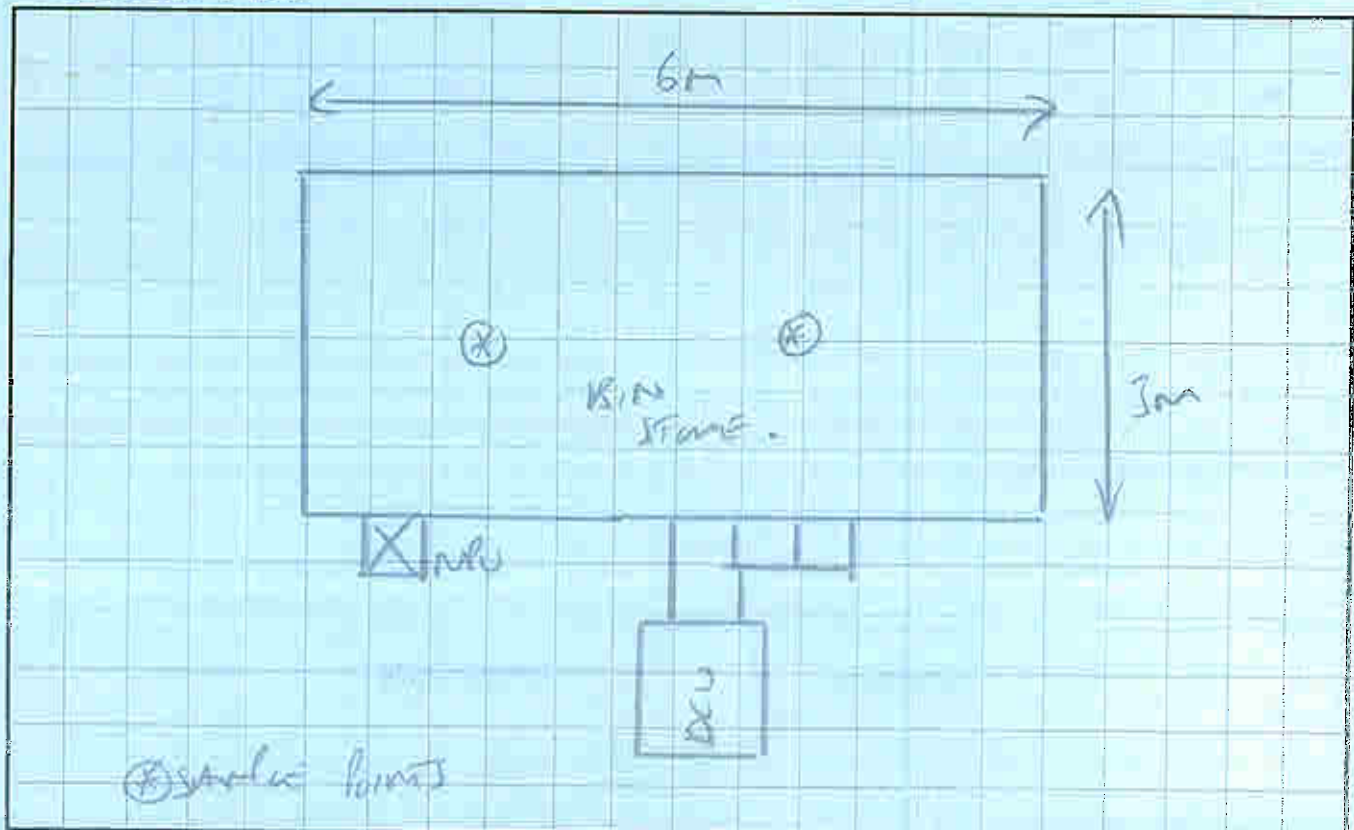

BROADLAND GROUP LIMITED

AIR MONITORING REPORT

Client Details: <u>DSA REMEDIATION,</u>	Project No: <u>R02/5223/08</u>
<u>STATION ROAD,</u>	Date samples taken: <u>15/1/10</u>
<u>DEEPEN</u>	Date of analysis: <u>17/1/10</u>
<u>SHESSED</u>	Number of samples: <u>3</u>
	Location of Analysis: <u>Site/Lab</u>

Site: <u>LOWFIELDS SCHOOL, DIXON AVENUE, YORK</u>
Location: <u>BIN STORE</u>

Purpose/detail of tests/scope of works:
<u>CLEARANCE FOLLOWING REMOVAL OF AIR CEILING.</u>
<u>AND PERSONAL whilst removing debris to boiler room wall</u>

Environmental Measurements:		Equipment used:	
Site Pressure (hPa)	<u>1006</u>	Microscope Serial Number	<u>02</u>
Site Temperature (°C)	<u>3</u>	Graticule Diameter μm	<u>100</u>
Calibration Pressure (hPa)	<u>1010</u>	Effective Filter Area (mm^2)	<u>780</u>
Calibration Temperature (°C)	<u>21</u>	HSE/NPL Test Slide Band	<u>IV</u>
Correction Required	<u>Yes / No</u>	Rotameter Number	<u>52</u>
Barometer Serial No.	<u>02</u>	Stage Micrometer Serial No.	<u>02</u>
		Thermometer Serial No.	<u>02</u>

- Sampling and fibre counting procedures are those described by HSE documents HSG 248.
- Results are expressed as concentrations of fibres per millilitre (l ml^{-1}) of air sampled. The detection limit of the sampling and counting method is 0.010 l ml^{-1} . Concentrations below this are reported as $< 0.010 \text{ l ml}^{-1}$. Concentration results are calculated to three decimal places to distinguish between 0.009 l ml^{-1} and 0.010 l ml^{-1} . The reporting convention for the fibre concentrations observed is as follows:

Calculated Results	Report as:
Result $< 0.010 \text{ l ml}^{-1}$	$< 0.010 \text{ l ml}^{-1}$
$0.010 > \text{Result} < 0.015 \text{ l ml}^{-1}$	Result to 3 decimal places
Result $> 0.015 \text{ l ml}^{-1}$	Result to 2 decimal places
- Opinions and interpretations expressed herein are outside the scope of UKAS accreditation.



Dunston Innovation Centre, Dunston Road, Chesterfield, S41 8NG
 Telephone: 01246 267954 Fax: 01246 267959
 E-mail: info@broadland-group.co.uk



2630

BROADLAND GROUP LIMITED

CERTIFICATE OF REOCCUPATION

STAGE 3 - AIR MONITORING - Sampling and fibre counting procedures are those described in HSG248

See Air Monitoring Report Number PA/5223/07

Clearance Air Monitoring	Yes/No	Comments/values
3.1 All areas are dry	Yes/No	
3.2 Air movers off and sealed	Yes/No	SMALL LEAK TO CORNER CONTAINED.
3.3 No evidence of lock down sprays	Yes/No	
3.4 Original floor surface uncovered	Yes/No	
3.5 Disturbance used (state type)	Yes/No	PAINTING TO ALL SURFACES EXCEPT CEILING.
3.6 Total time of disturbance	Minutes	
3.7 Area or volume of enclosure	m ² 72 m ³	
3.8 Number of air samples collected	2 ANALYSES	6 x 1 x 4 m

Result - **PASS** **FAIL**

Date: 17/1/10

Time: 18.45

Name: K. Palmer
Signature: [Signature]

STAGE 4 - FINAL ASSESSMENT

Comments	Yes/No
Enclosure: air locks and transit routes removed	
All former work areas, transit/waste routes free from visible debris, asbestos sacks + waste	Yes/No
All ACMS in the scope of works have been removed + any remaining are in a safe condition	Yes/No
Photos	Yes/No
Result - PASS FAIL	
Date: <u>17/1/10</u>	Time: <u>19.25</u>
Name: <u>K. Palmer</u> Signature: <u>[Signature]</u>	

This area CAN/CANNOT be returned to normal occupation.

Options and interpretations expressed herein are outside the scope of UKAS accreditation.

Comments: 4th STAGE AND TRANSIT ROUTES CHECKED BY TALEN LIGHT AS NIGHT TIME AND NO POWER TO UNIT.

Signed: [Signature] Job Title: Surveyor

Print Name: K. Palmer Date: 17/1/10

Certificate Received by (Signed): [Signature] Representing: client/contractor

Print Name: S. Hauser Date: 17/1/10

atac

COR2 - JAN 09

Dunston Innovation Centre, Dunston Road, Chesterfield, S41 8NG
Tel: 01246 267954 Fax: 01246 267959
E-mail: info@broadland-group.co.uk



